

30

STATION POST	
CAT. NO.	16PT00
345 kV	1300 kV BIL
TR. NO. 324	

ENG. MGR.  
 2 ENG.  
 PURCH.  
 MKTG.  
 PLT. MGR.  
 COST  
 PROD.  
 INSP.  
 GLAZE  
 BUSHING  
 MAKING  
 SHIP.  
 ASSEM.  
 MODEL  
 MACH.  
 45  
 TOOLING  
 CER. LAB.  
 EL. LAB.  
 Q.A.

DIMENSIONS

LEAKAGE DISTANCE IN 231

MECHANICAL VALUES

CANTILEVER STRENGTH LB 1,000  
 TENSILE STRENGTH LB 25,000  
 TORSION STRENGTH IN-LB 90,000  
 COMPRESSION STRENGTH LB 75,000

ELECTRICAL VALUES

IMPULSE FLASHOVER-POS. kV 1,410  
 60 HERTZ WITHSTAND-WET kV 525  
 IMPULSE WITHSTAND kV 1,300


RADIO INFLUENCE VOLTAGE DATA

60 HERTZ TEST VOLTAGE kV 220  
 MAXIMUM RIV @ 1000 kHz  $\mu$ V 1,000

PACKING INFORMATION


NET WEIGHT ,STACK LB 437  
 PACKED WEIGHT ,STACK LB 512  
 NO. IN STANDARD PACKAGE 1

4 HOLES EACH END  
 5/8-11 + .015" ON 5" B.C.

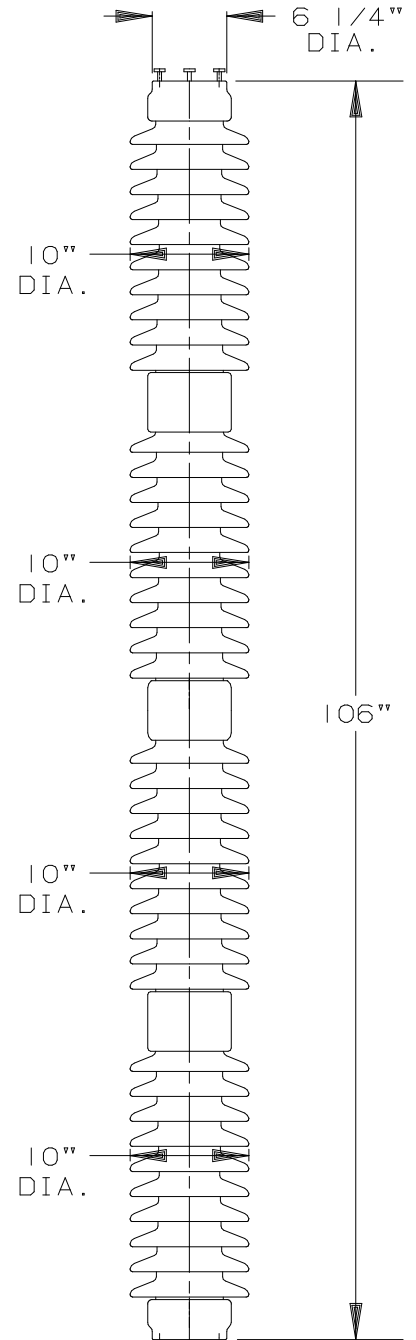

THIS DRAWING IS THE PROPERTY OF  
 VICTOR INSULATORS, INC. AND CONTAINS  
 PROPRIETARY AND CONFIDENTIAL INFORMATION  
 WHICH MUST NOT BE DUPLICATED, USED,  
 OR DISCLOSED OTHER THAN AS EXPRESSLY  
 AUTHORIZED BY VICTOR INSULATORS, INC.

5-04-99	DG	AS	A
07-29-94	RR		



Victor Insulators, Inc.  
 280 MAPLE AVENUE  
 VICTOR, NEW YORK 14564  
 TELEPHONE: (716)924-2127

16PT00