

30

STATION POST	
CAT. NO. 16PT01	
345 kV	1300 kV BIL
TR. NO. 367	

- 1 ENG. MGR.
- 2 ENG.
- PURCH.
- 1 MKTG.
- PLT. MGR.
- COST
- PROD.
- INSP.
- GLAZE
- BUSHING
- MAKING
- SHIP.
- ASSEM.
- MODEL
- MACH.
- 45
- TOOLING
- CER. LAB.
- 1 EL. LAB.
- Q.A.

DIMENSIONS

LEAKAGE DISTANCE IN 231

MECHANICAL VALUES

CANTILEVER STRENGTH LB 1,450
 TENSILE STRENGTH LB 20,000
 TORSION STRENGTH IN-LB 40,000
 COMPRESSION STRENGTH LB 60,000

ELECTRICAL VALUES

IMPULSE FLASHOVER-POS. kV 1,410
 60 HERTZ WITHSTAND-WET kV 525
 IMPULSE WITHSTAND kV 1,300


RADIO INFLUENCE VOLTAGE DATA

60 HERTZ TEST VOLTAGE kV 220
 MAXIMUM RIV @ 1000 kHz μ V 1,000

PACKING INFORMATION

NET WEIGHT ,STACK LB 455
 PACKED WEIGHT ,STACK LB 490
 NO. IN STANDARD PACKAGE 1


4 HOLES
 5/8-11 + .015" ON 5" B.C.

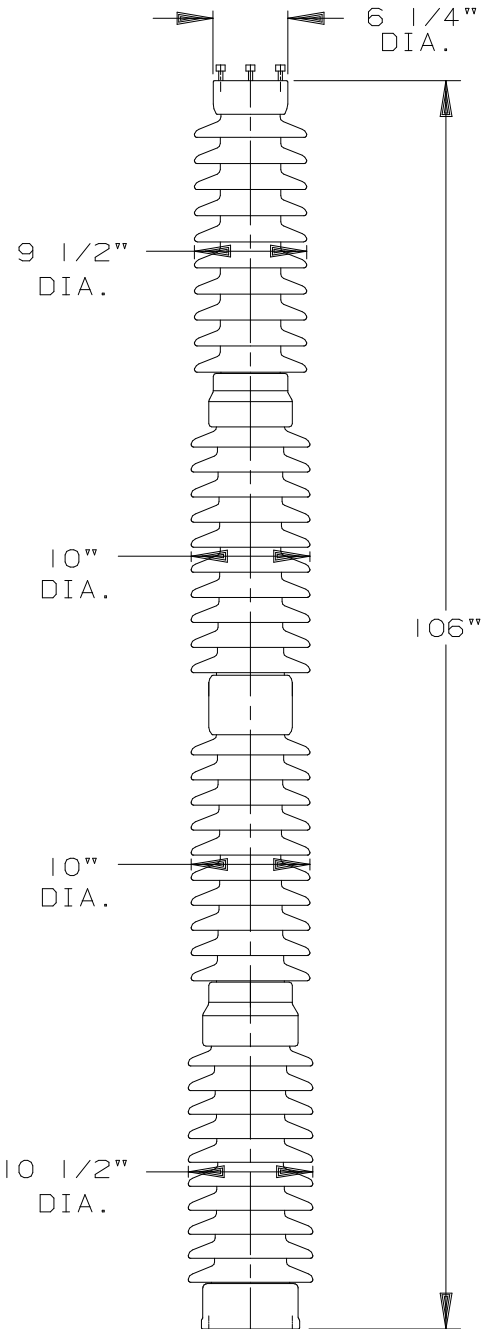

4 HOLES
 3/4-10 + .015" ON 7" B.C.

THIS DRAWING IS THE PROPERTY OF
 VICTOR INSULATORS, INC. AND CONTAINS
 PROPRIETARY AND CONFIDENTIAL INFORMATION
 WHICH MUST NOT BE DUPLICATED, USED,
 OR DISCLOSED OTHER THAN AS EXPRESSLY
 AUTHORIZED BY VICTOR INSULATORS, INC.

5-04-99	DG	AS	A
6-24-94		PP	



Victor Insulators, Inc.
 280 MAPLE AVENUE
 VICTOR, NEW YORK 14564
 TELEPHONE: (716)924-2127

16PT01