

30

STATION POST	
CAT. NO.	16PA30
500 kV	1800 kV BIL
TR. NO. 391	

1 ENG. MGR.  
2 ENG.  
PURCH.  
1 MKTG.  
PLT. MGR.  
COST  
PROD.  
INSP.  
GLAZE  
BUSHING  
MAKING  
SHIP.  
ASSEM.  
MODEL  
MACH.  
45  
TOOLING  
CER. LAB.  
EL. LAB.  
E. MEDIA

DIMENSIONS

LEAKAGE DISTANCE IN 330

MECHANICAL VALUES

CANTILEVER STRENGTH LB 1,400  
TENSILE STRENGTH LB 20,000  
TORSION STRENGTH IN-LB 40,000  
COMPRESSION STRENGTH LB 60,000

ELECTRICAL VALUES


IMPULSE FLASHOVER-POS. kV 2,000  
60 HERTZ WITHSTAND-WET kV 710  
IMPULSE WITHSTAND kV 1,800

RADIO INFLUENCE VOLTAGE DATA

60 HERTZ TEST VOLTAGE kV 318  
MAXIMUM RIV @ 1000 kHz  $\mu$ V 500  
RIV: TESTED WITHOUT CORONA RINGS

PACKING INFORMATION

NET WEIGHT ,STACK LB 620  
PACKED WEIGHT ,STACK LB 705  
NO. IN STANDARD PACKAGE  $\frac{1}{2}$

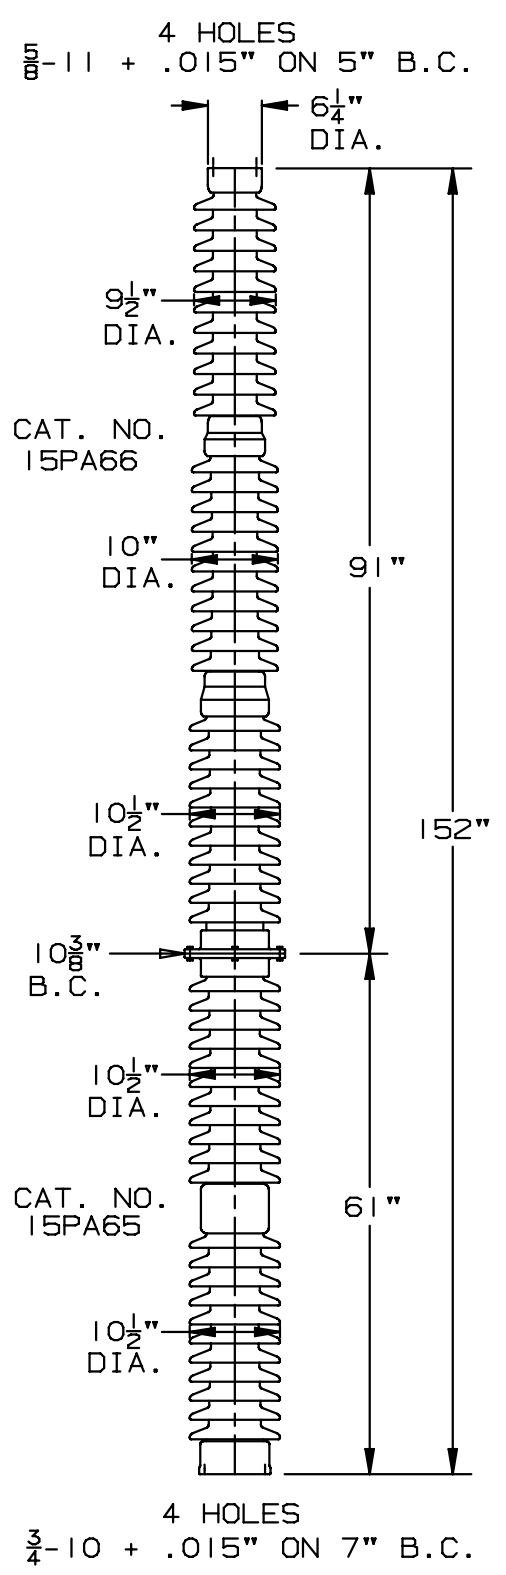

THIS DRAWING IS THE PROPERTY OF VICTOR INSULATORS, INC. AND CONTAINS PROPRIETARY AND CONFIDENTIAL INFORMATION WHICH MUST NOT BE DUPLICATED, USED, OR DISCLOSED OTHER THAN AS EXPRESSLY AUTHORIZED BY VICTOR INSULATORS, INC.

7-24-01	TM	PP	AS	E
5-8-95		PAP		D
7-12-93	RR	PP	RKH	C
6-4-93	RR	PAP	AES	B
9-17-92	BA	PAP	AES	A



**Victor Insulators, Inc.**  
280 MAPLE AVENUE  
VICTOR, NEW YORK 14564  
TELEPHONE: (716)924-2127

16PA30