

30

STATION POST

CAT. NO. 16PT04

345 kV

1300 kV BIL

1 ENG. MGR.
2 ENG.
PURCH.
1 MKTG.
PLT. MGR.
COST
PROD.
INSP.
GLAZE
BUSHING
MAKING
SHIP.
ASSEM.
MODEL
MACH.
45
TOOLING
CER. LAB.
1 EL. LAB.
1 E. MEDIA

DIMENSIONS

LEAKAGE DISTANCE IN 231

MECHANICAL VALUES

CANTILEVER STRENGTH LB 1,000
TENSILE STRENGTH LB 20,000
TORSION STRENGTH IN-LB 40,000
COMPRESSION STRENGTH LB 60,000

ELECTRICAL VALUES

IMPULSE FLASHOVER-POS. kV 1,410
60 HERTZ WITHSTAND-WET kV 525
IMPULSE WITHSTAND kV 1,300


RADIO INFLUENCE VOLTAGE DATA

60 HERTZ TEST VOLTAGE kV 220
MAXIMUM RIV @ 1000 kHz μ V 1,000

PACKING INFORMATION

NET WEIGHT ,STACK LB 376
PACKED WEIGHT ,STACK LB 411
NO. IN STANDARD PACKAGE 1


4 HOLES EACH END
 $\frac{5}{8}$ -11 + .015" ON 5" B.C.

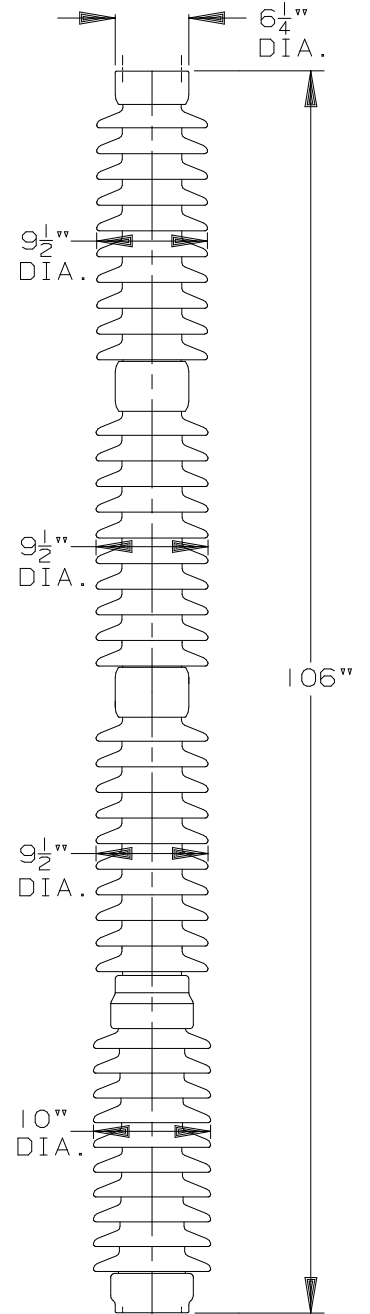

THIS DRAWING IS THE PROPERTY OF VICTOR INSULATORS, INC. AND CONTAINS PROPRIETARY AND CONFIDENTIAL INFORMATION WHICH MUST NOT BE DUPLICATED, USED, OR DISCLOSED OTHER THAN AS EXPRESSLY AUTHORIZED BY VICTOR INSULATORS, INC.

FILE: 16PT04

7-24-01	TM	PP	AS	A
10-12-94	CP	PP		



Victor Insulators, Inc.
280 MAPLE AVENUE
VICTOR, NEW YORK 14564
TELEPHONE: (716)924-2127

16PT04