


**STATION POST**

CAT. NO. 17PA25

115 kV 550 kV BIL

TR 287

4 HOLES 5/8"-11 +.015  
ON 5" B.C., BOTH ENDS

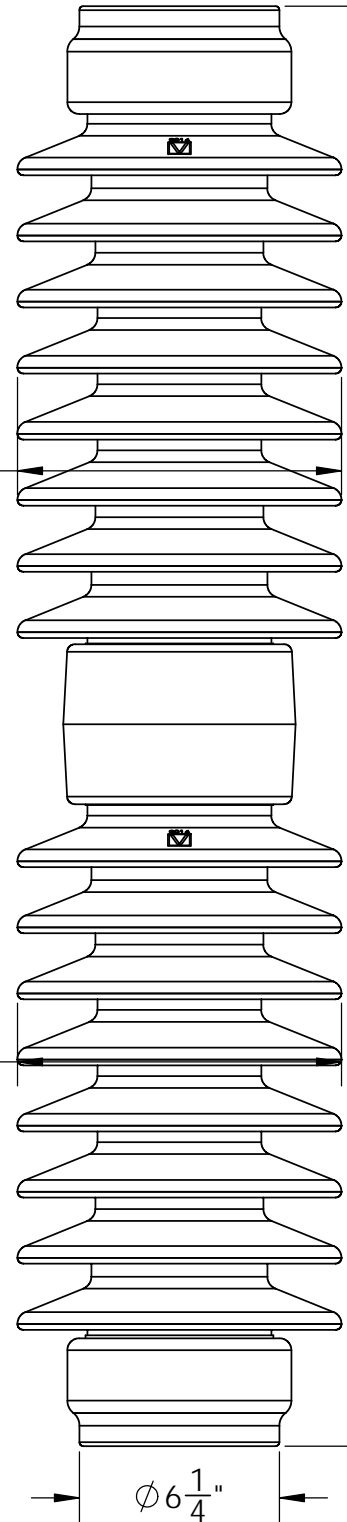

DIMENSIONS:  
LEAKAGE DISTANCE IN 99

MECHANICAL VALUES:  
CANTILEVER STRENGTH LB 2,600  
TENSION STRENGTH LB 25,000  
TORSION STRENGTH IN-LB 90,000  
COMPRESSION STRENGTH LB 75,000

ELECTRICAL VALUES:  
IMPULSE FLASHOVER-POSITIVE kV 610  
60 HERTZ WITHSTAND-WET kV 230  
IMPULSE WITHSTAND kV 550

RADIO INFLUENCE VOLTAGE DATA:  
60 HERTZ TEST VOLTAGE TO GROUND kV 73  
MAXIMUM R.I.V. @ 1000 kHz  $\mu$ V 200

PACKAGING INFORMATION:  
NET WEIGHT, LB 150  
PACKED WEIGHT LB 165  
NO. IN STANDARD PACKAGE 1

- 1 ENG. MGR
- 2 ENG
- 1 PURCH.
- 1 MKTG.
- 1 PLT.MGR.
- 1 COST
- 1 PROD.
- 1 INSP
- 1 GLAZE
- 1 BUSHING
- 1 MAKING
- 1 SHIP
- 1 ASSEM
- 1 MODEL
- 1 MACH.
- 45
- 1 TOOLING
- 1 CER LAB
- 1 EL LAB
- 1 E.MEDIA

THIS DRAWING IS THE PROPERTY OF VICTOR INSULATORS, INC. AND CONTAINS PROPRIETARY AND CONFIDENTIAL INFORMATION WHICH MUST NOT BE DUPLICATED, USED, OR DISCLOSED OTHER THAN AS EXPRESSLY AUTHORIZED BY VICTOR INSULATORS, INC.

APPROVED  
By A. E. Schwalm at 2:08 pm, Oct 03, 2016



**Victor Insulators, Inc.**  
280 Maple Avenue  
Victor, New York 14564  
Telephone: (585)924-2127  
www.victorinsulators.com

**17PA25**

09-28-16

TM

SUPERSEDES DWG 17PA25 DATED 09-27-11