


COMPOSITE INSULATOR

CAT. NO. VI 35U

- 1 ENG. MGR
- 2 ENG
- PURCH.
- 1 MKTG.
- PLT.MGR.
- COST
- PRD.
- INSP
- GLAZE
- BUSHING
- MAKING
- SHIP
- ASSEM
- MODEL
- MACH.
- 45
- TOOLING
- CER LAB
- 1 EL LAB
- 1 E.MEDIA

EXCEPT BASE THREADING, ALL DIMENSIONS ARE IN mm

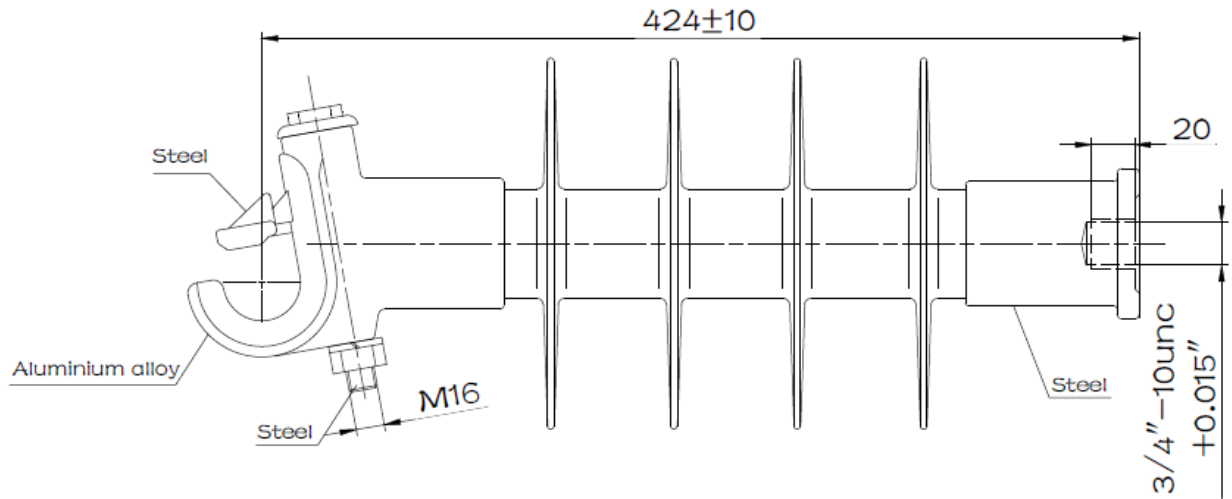

TECHNICAL SPECIFICATIONS:

LEAKAGE DISTANCE	mm	657
DRY ARCING DISTANCE	mm	264
SPECIFIED CANTILEVER LOAD (SCL)	kN	12.5
SPECIFIED TENSILE LOAD(STL)	kN	22
60 HERTZ FLASHOVER, DRY	kV	120
60 HERTZ FLASHOVER, WET	kV	85
IMPULSE FLASHOVER, POSITIVE	kV	195
RIV 60 HERTZ TEST VOLTAGE	kV	22
MAXIMUM RIV @ 1000 KHz	µV	2.5

THIS DRAWING IS THE PROPERTY OF VICTOR INSULATORS, INC. AND CONTAINS PROPRIETARY AND CONFIDENTIAL INFORMATION WHICH MUST NOT BE DUPLICATED, USED, OR DISCLOSED OTHER THAN AS EXPRESSLY AUTHORIZED BY VICTOR INSULATORS, INC.

APPROVED
By A. E. Schwalm at 9:29 am, Jun 29, 2018



Victor Insulators, Inc.

280 Maple Avenue
Victor, New York 14564
Telephone: (585)924-2127
www.victorinsulators.com

VI 35U

06-28-18

TM