

**COMPOSITE  
TIE TOP LINE POST**

CAT. NO. VI 51-3F

ANSI CLASS 51-3F

F NECK

- 1 ENG. MGR
- 2 ENG
- PURCH.
- 1 MKTG.
- PLT.MGR.
- COST
- PRD.
- INSP
- GLAZE
- BUSHING
- MAKING
- SHIP
- ASSEM
- MODEL
- MACH.
- 45
- TOOLING
- CER LAB
- 1 EL LAB
- 1 E.MEDIA

**DIMENSIONS:**

LEAKAGE DISTANCE mm 662

**MECHANICAL VALUES:**

SPECIFIED CANTILEVER LOAD(SCL) kN 12.5

SPECIFIED TENSILE LOAD(STL) kN 8.9

**ELECTRICAL VALUES:**

60 HERTZ FLASHOVER-DRY kV 135

60 HERTZ FLASHOVER-WET kV 100

IMPULSE FLASHOVER-POS kV 215

**RADIO INFLUENCE VOLTAGE DATA:**


60 HERTZ TEST VOLTAGE TO GROUND kV 22

MAXIMUM R.I.V. @ 1000 kHz μV 100

**PACKAGING INFORMATION:**

NET WEIGHT, EACH kg 5.2

THIS DRAWING IS THE PROPERTY OF  
VICTOR INSULATORS, INC. AND CONTAINS  
PROPRIETARY AND CONFIDENTIAL INFORMATION  
WHICH MUST NOT BE DUPLICATED, USED,  
OR DISCLOSED OTHER THAN AS EXPRESSLY  
AUTHORIZED BY VICTOR INSULATORS, INC.

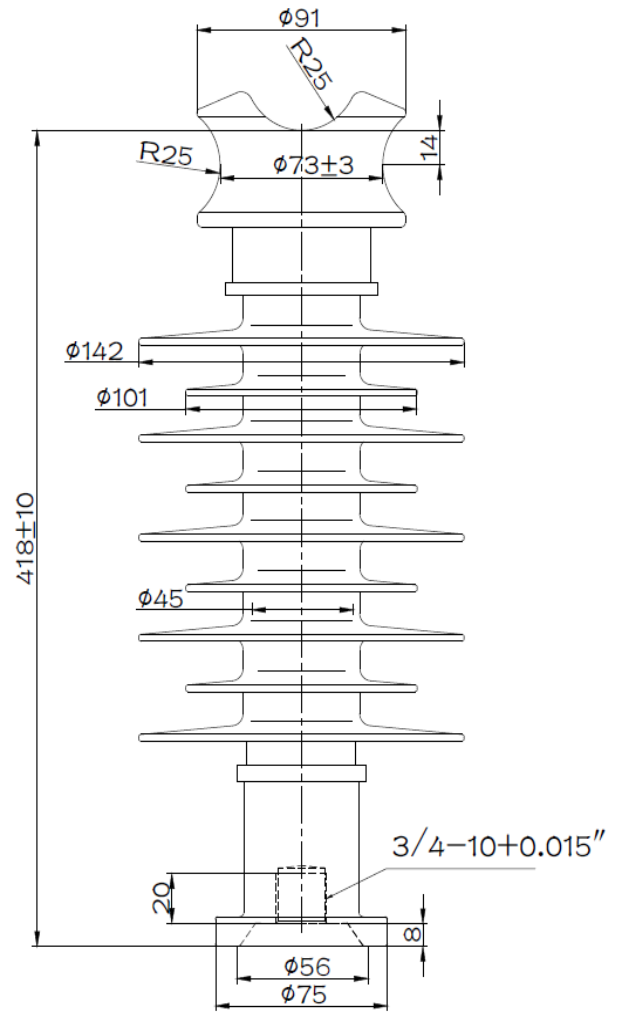

**APPROVED**  
By A. E. Schwalm at 7:45 am, Apr 20, 2021

04-20-21

TM



**Victor Insulators, Inc.**

280 Maple Avenue  
Victor, New York 14564  
Telephone: (585)924-2127  
www.victorinsulators.com

**VI 51-3F**